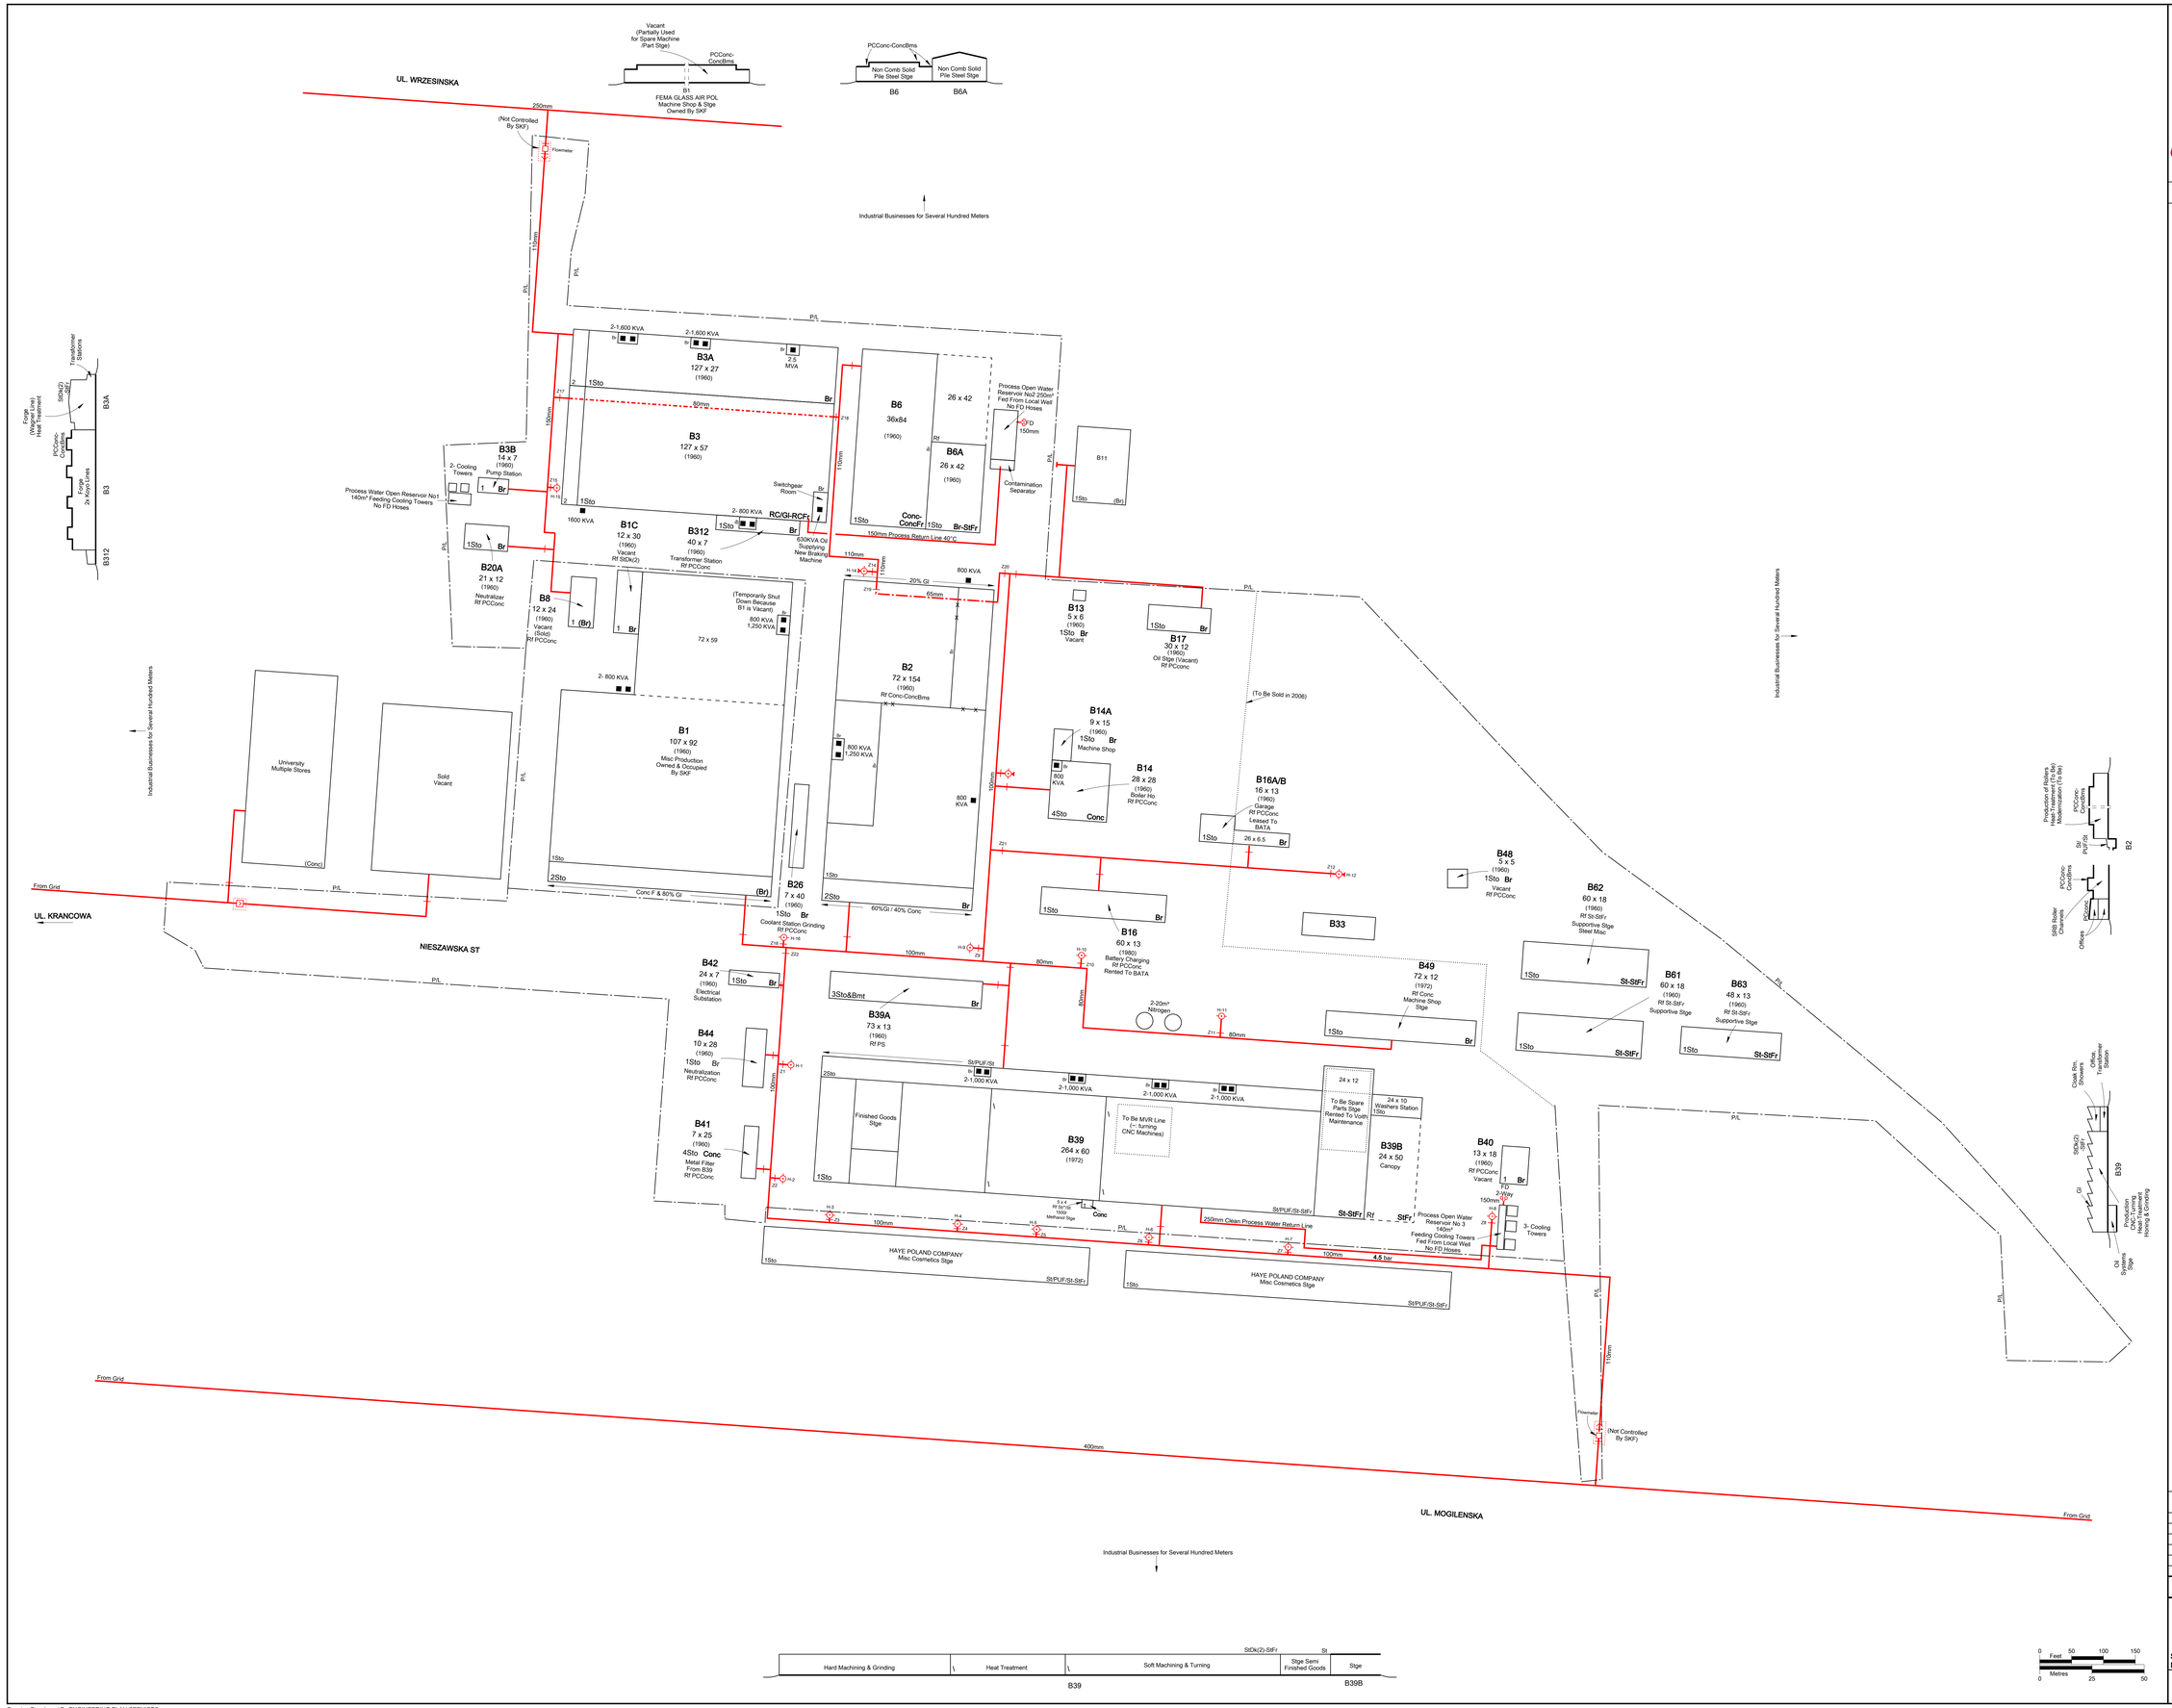

FM Global

LEGEND

- Dry or frost proof hydrant with fire department pumper connection (number of horns indicates number of hose outlets).
- Gate valve, non-rising stem, pressure relief valve (PRV), quick opening valve (QOV) or as noted on plan.
- Fire service meter.
- Check valve (Detector check or back flow preventor when indicated).
- Transformer owned by the insured
- Fire doors complete on all floors unless indicated by the floor number. Sub-standard doors shown with a light line

REVISIONS

DR	CH	DATE	CHANGES MADE
KJC		May-28-14	For Regular Risk Evaluation of J. Fabiszak; May-15-14
RDR		Dec-12-12	For Interim Risk Evaluation of J. Fabiszak, Nov-9-12
FIE		Aug-1-11	For Baseline Risk Evaluation of J. Fabiszak, Jul-15-11
DPS		Feb-24-09	For Interim Risk Evaluation of J. Krawczyk, Jan-28-09
RD		Dec-12-07	For Baseline Risk Evaluation of M. Steppel Nov-28-07

SKF
"Industrial Markets"
"SKF Polska S.A. & SKF Sverige AB-9109, 9840"
Poznan, Poland

Sketch by S. Beiderbeck
November 21, 2003

Scale :1 : 1000m
By C.J. Akin

FACTORY MUTUAL INSURANCE COMPANY
Engineering Plan Services
272 CENTRAL AVENUE, JOHNSTON, RI 02919-4949

INDEX PL0384.00

1/1

Drawing Developed By ENGINEERING PLAN SERVICES